



United States Department of Agriculture  
Rural Development - Nevada State Office

1390 S. Curry Street • Carson City, Nevada 89703-5146  
Phone: (775) 887-1222 • Fax: (775) 887-1287 • TDD: (775) 885-0633 • Web: <http://www.rurdev.usda.gov/nv>

March 20, 2006

Clearinghouse Coordinator  
Department of Administration  
Budget Division - State Clearinghouse  
209 E. Musser, Room 200  
Carson City, NV 89701

**RECEIVED**

MAR 21 2006

DEPARTMENT OF ADMINISTRATION  
OFFICE OF THE DIRECTOR  
BUDGET AND PLANNING DIVISION

**Subject: Town of Kingston – water distribution system line replacement**

Dear Coordinator:

Pursuant to the Memorandum of Understanding (MOU) between our agencies, this is to notify you that the USDA - Rural Development has received an application for a loan/grant from the Town of Kingston, Lander County, Nevada for the replacement of the water distribution system. Construction will primarily take place in previously disturbed roads and rights-of-way, but there will be a number of stream crossings.

Attached is map showing the location of the proposed project and a legal description of the Town of Kingston.

Unless the Clearinghouse Coordinator advises us otherwise, within fourteen days of this notice, we will assume that the final Clearinghouse comments will not be forthcoming and, therefore, the State Clearinghouse responsibilities of USDA - Rural Development will have been satisfied.

If you have questions or need additional information, please contact me at 775-887-1222, ext.22.

Sincerely,


Cheryl Couch  
Community Programs Specialist

Attachments

**Committed to the future of rural communities**

"USDA is an equal opportunity provider, employer and lender."  
To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W.,  
Washington, D.C. 20250-9410, or call (800) 795-3272 (voice) or (202) 720-6382 (TDD).


# TOWN OF KINGSTON – PROPOSED IMPROVEMENTS TO WATER SYSTEM – 2006

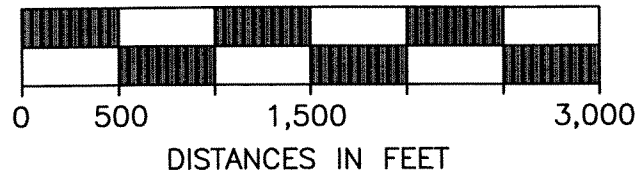

LEGEND:

EXIST. C-900 PVC OR DI	—————
EXIST. 4" PVC (IPS)	===== ===== =====
EXIST. 2" PVC (IPS)	.....
EXIST. OTHER PIPE	—————
PROPOSED NEW PIPE	————— 8"
PROPOSED FIRE HYDRANT	○

3 EXISTING 20,000 GALLON  
HORIZONTAL STEEL TANKS  
W/ 6" & 4" STEEL PIPING

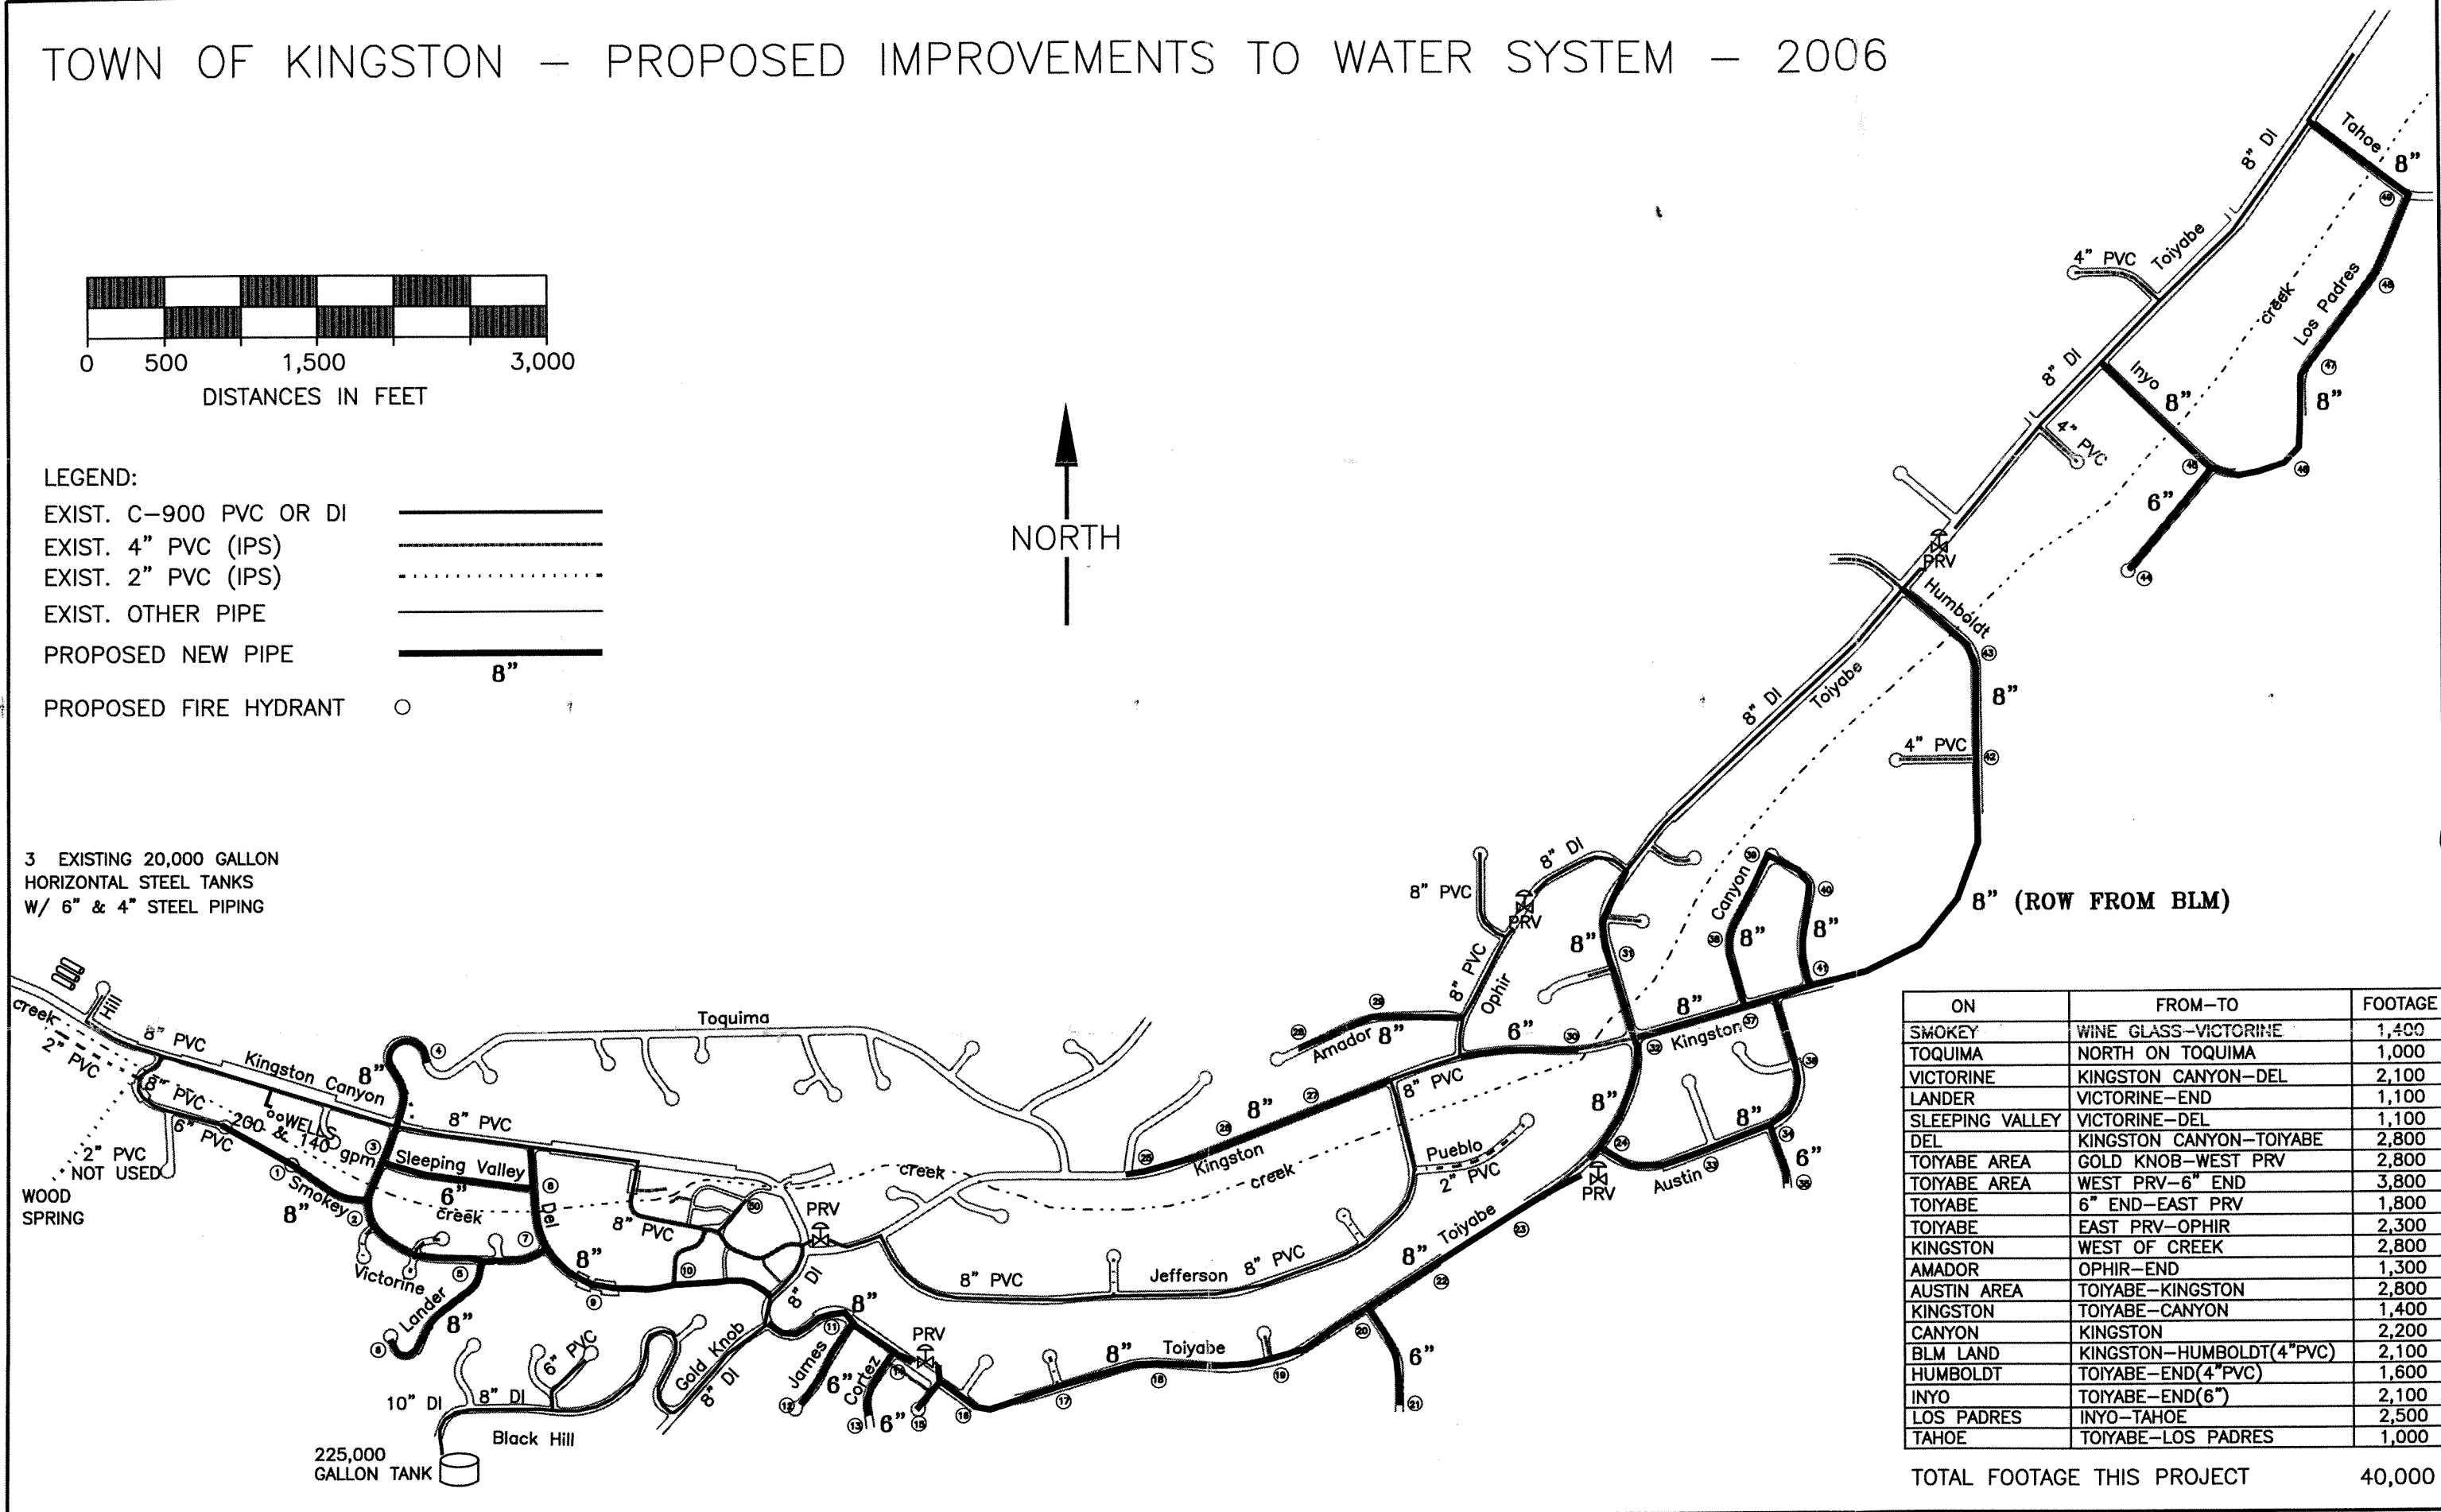

ON	FROM-TO	FOOTAGE
SMOKEY	WINE GLASS-VICTORINE	1,400
TOQUIMA	NORTH ON TOQUIMA	1,000
VICTORINE	KINGSTON CANYON-DEL	2,100
LANDER	VICTORINE-END	1,100
SLEEPING VALLEY	VICTORINE-DEL	1,100
DEL	KINGSTON CANYON-TOYABE	2,800
TOYABE AREA	GOLD KNOB-WEST PRV	2,800
TOYABE AREA	WEST PRV-6" END	3,800
TOYABE	6" END-EAST PRV	1,800
TOYABE	EAST PRV-OPHIR	2,300
KINGSTON	WEST OF CREEK	2,800
AMADOR	OPHIR-END	1,300
AUSTIN AREA	TOYABE-KINGSTON	2,800
KINGSTON	TOYABE-CANYON	1,400
CANYON	KINGSTON	2,200
BLM LAND	KINGSTON-HUMBOLDT(4" PVC)	2,100
HUMBOLDT	TOYABE-END(4" PVC)	1,600
INYO	TOYABE-END(6")	2,100
LOS PADRES	INYO-TAHOE	2,500
TAHOE	TOYABE-LOS PADRES	1,000

TOTAL FOOTAGE THIS PROJECT 40,000